


- NOTE: PIPELINE MARKERS TO BE LOCATED:
1. EVERY 1000' ALONG THE SEWER FORCE MAIN FITTINGS WHERE THE ALIGNMENT CHANGES
  2. BESIDE MANHOLES WHERE VEGETATIVE GROWTH IS HIGH FOR LOCATING PURPOSES
  3. OR AS DIRECTED BY THE ENGINEER

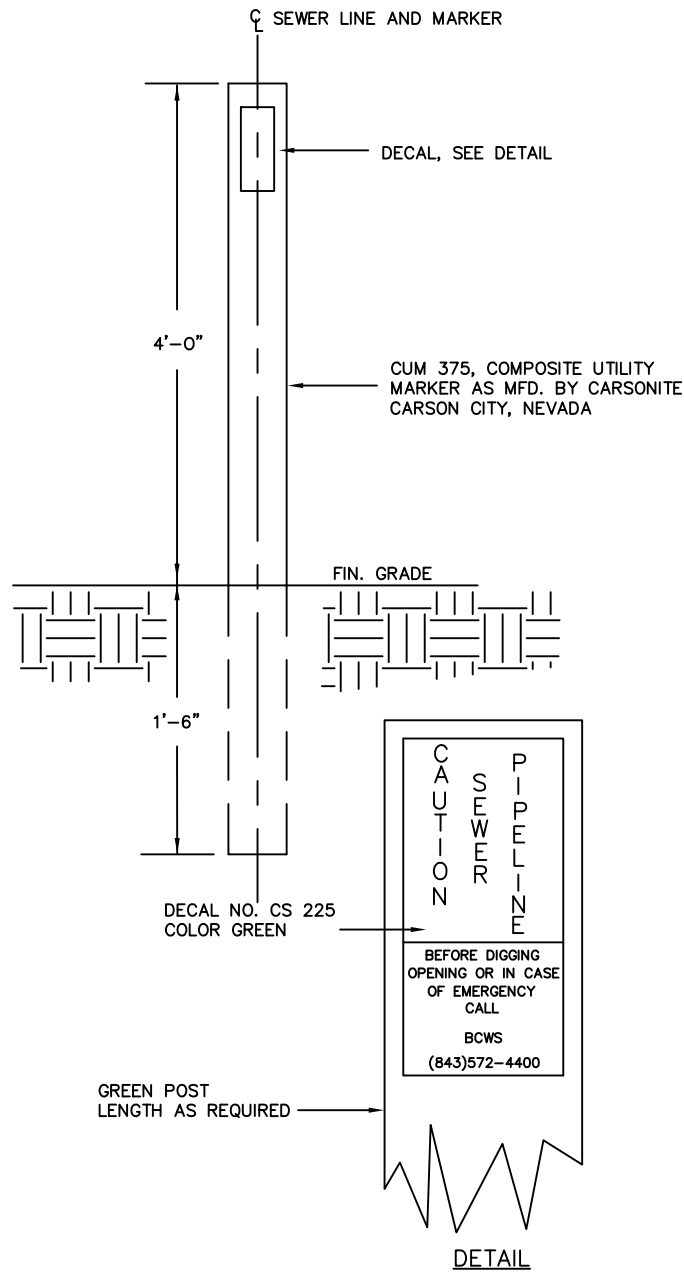

## LINE MARKER

NOT TO SCALE

## SEWER PANEL 2E

BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 05/15/20