


CONCRETE PERSONNEL PAD SHALL HAVE ADEQUATE
SLOPE TO PROVIDE POSITIVE DRAINAGE AWAY FROM
THE WET WELL.

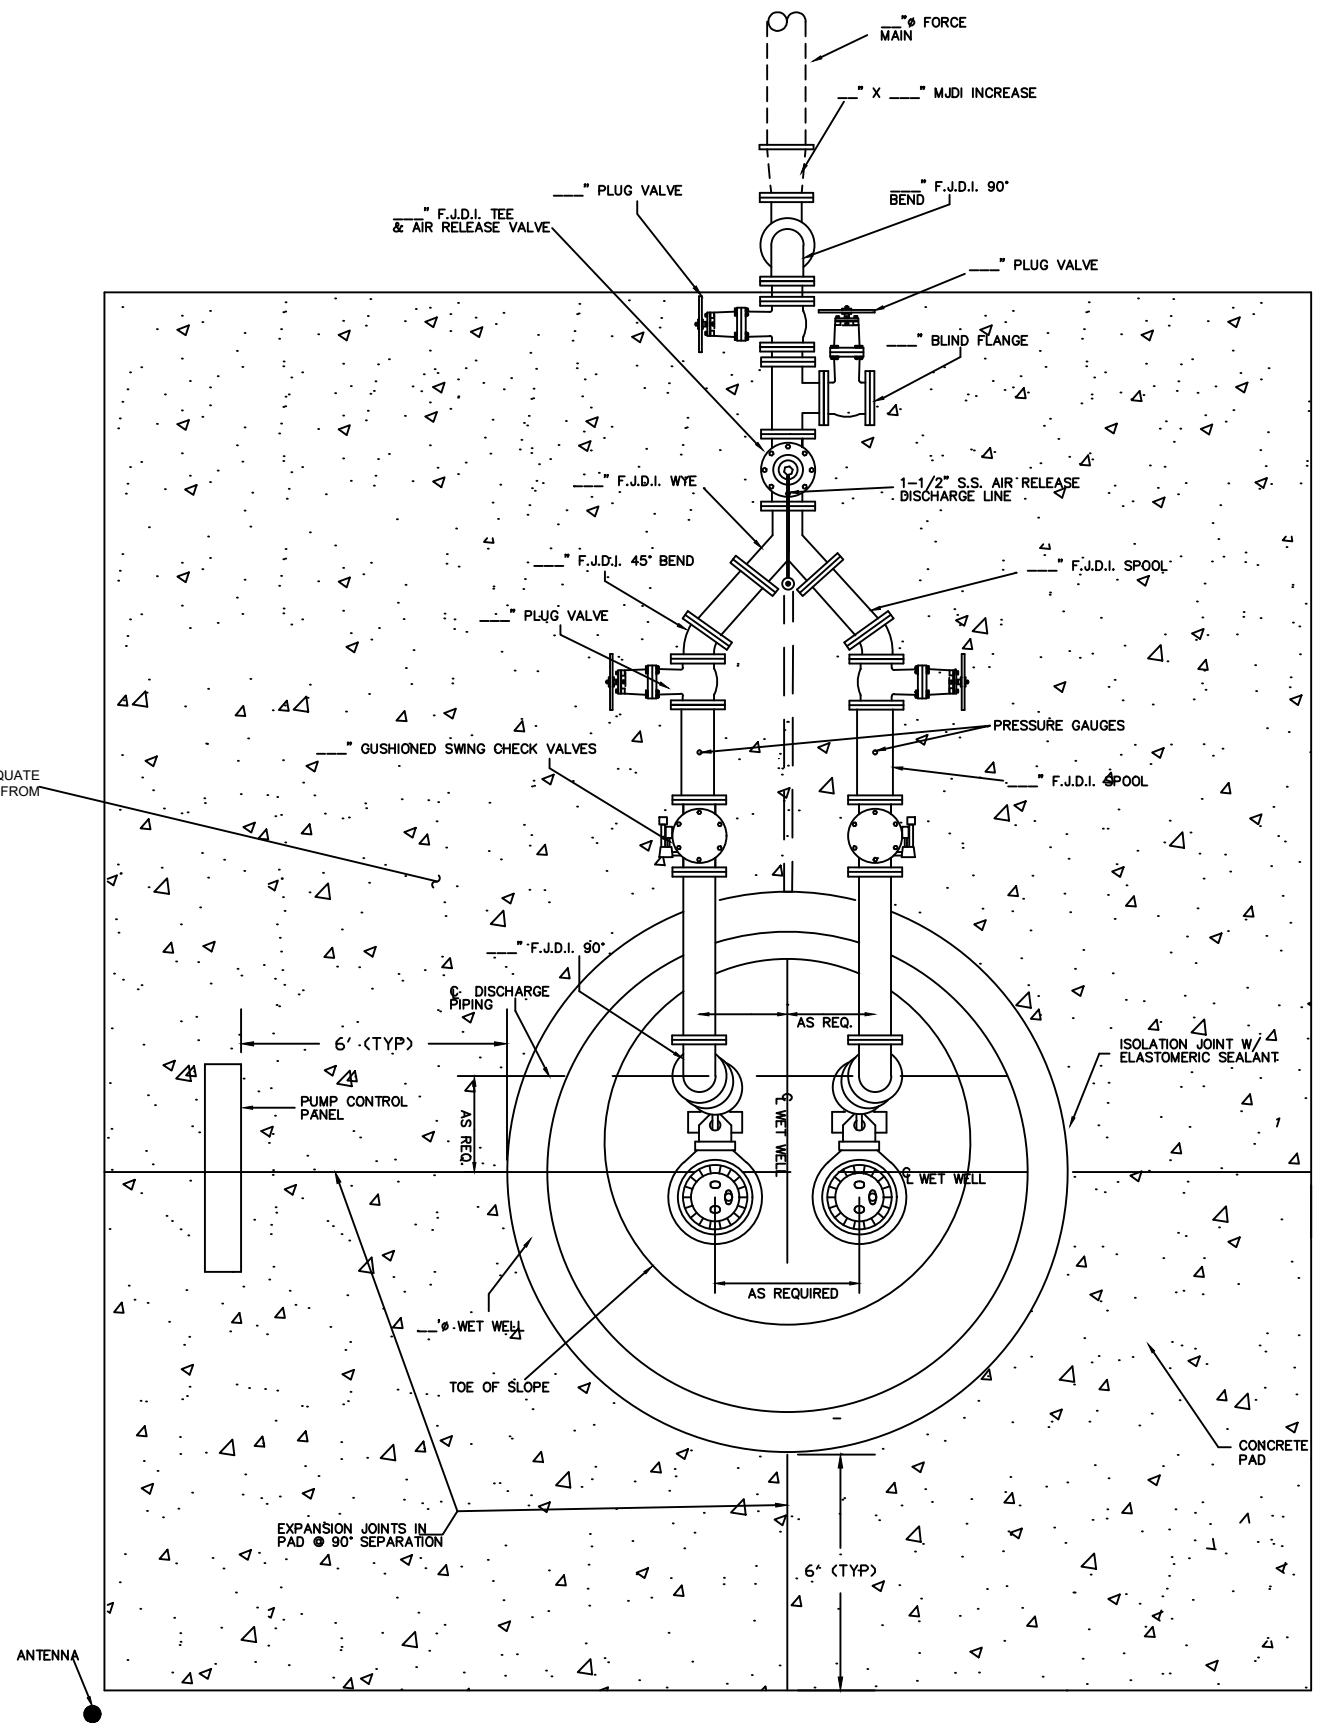

TYPICAL SMALL PUMP STATION
PLAN VIEW

NOT TO SCALE

PLAN

SEWER PANEL 3A

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS
REVISED 05/15/2020