


NOTES:

1. 36" MINIMUM COVER ON P.E. TUBING TO BE WITHIN 12" OF PEDESTAL.
2. VALVE SHALL BE INSTALLED WITH A VALVE BOX, COVER, AND CONCRETE VALVE MARKER STAMPED "ARV".
3. THE WIRE AND TAPE SHALL MEET BCWS STANDARDS.
4. TRACER WIRE SHALL BE BLUE IN COLOR FOR WATER MAIN.

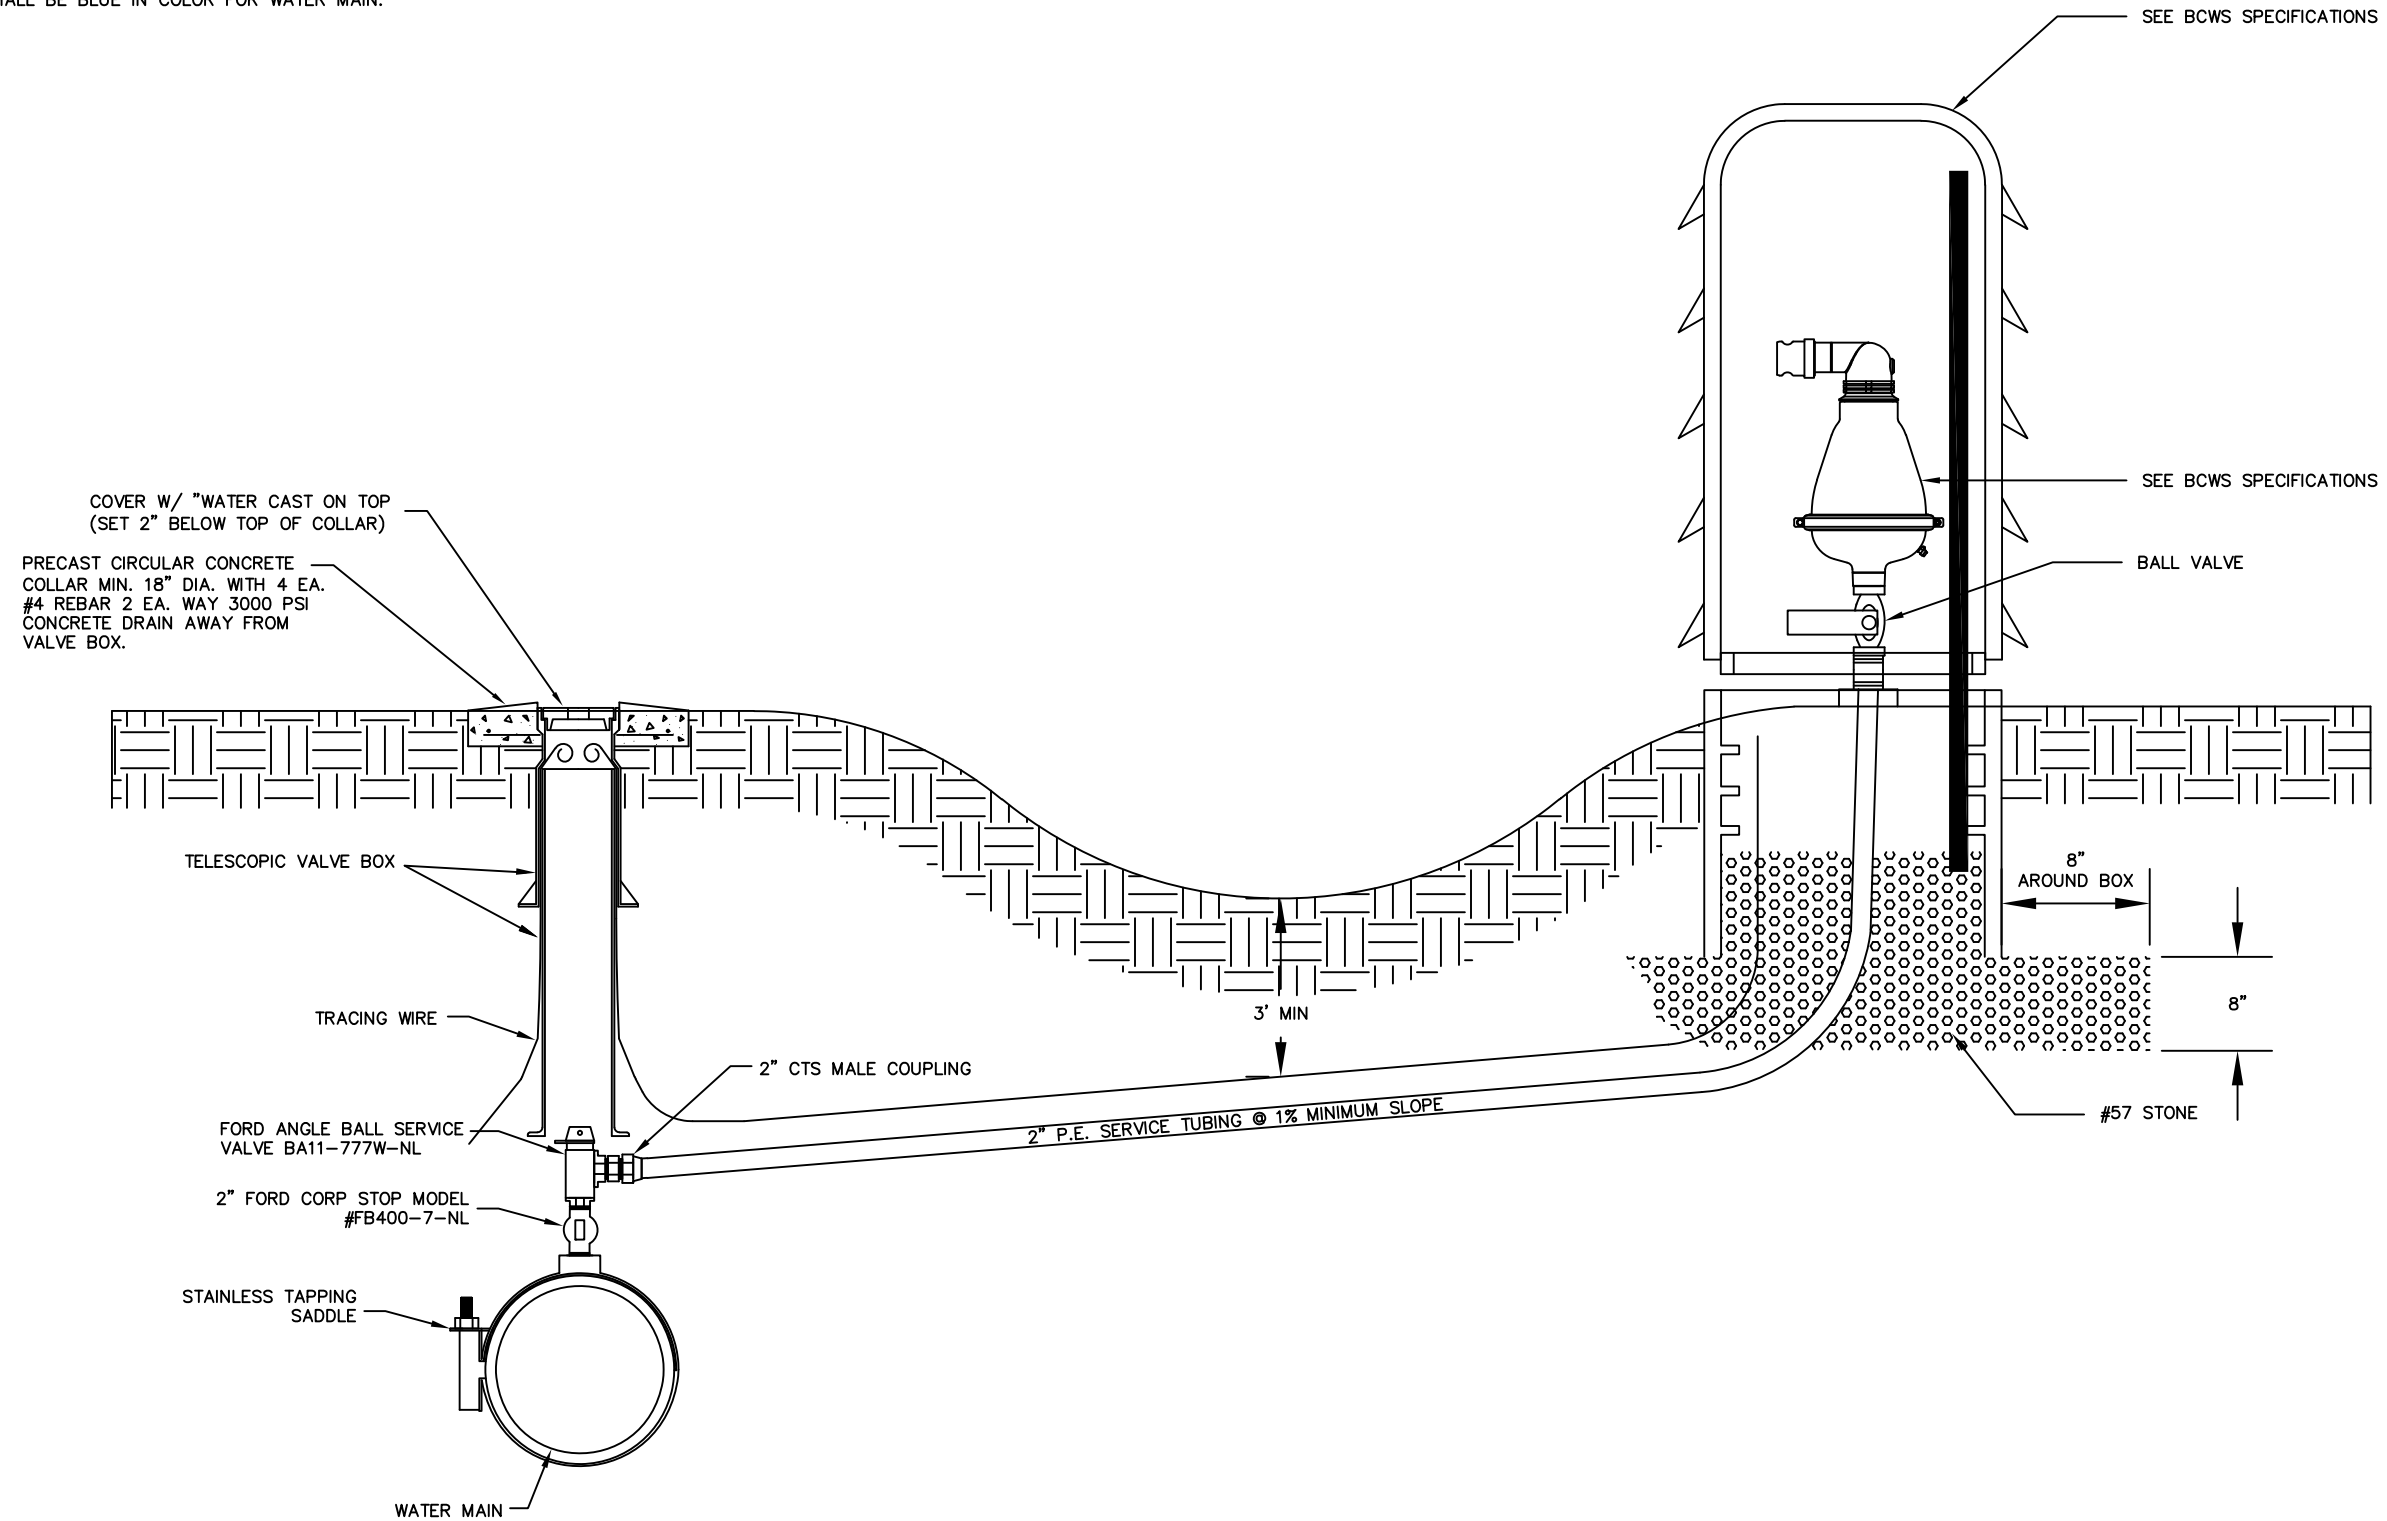

WATER ABOVE GROUND AIR RELEASE VALVE
NOT TO SCALE

WATER PANEL 11A

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS

Rev. 05/15/20