NOTE:

1. MEGALUG GLANDS SHALL BE USED ON ALL MECHANICAL JOINTS.
2. SEE APPENDIX F29 FOR BCWS APPROVED HYDRANTS
3. PAINTED RED TO OPEN LEFT.
4. POLY WRAP DIP.

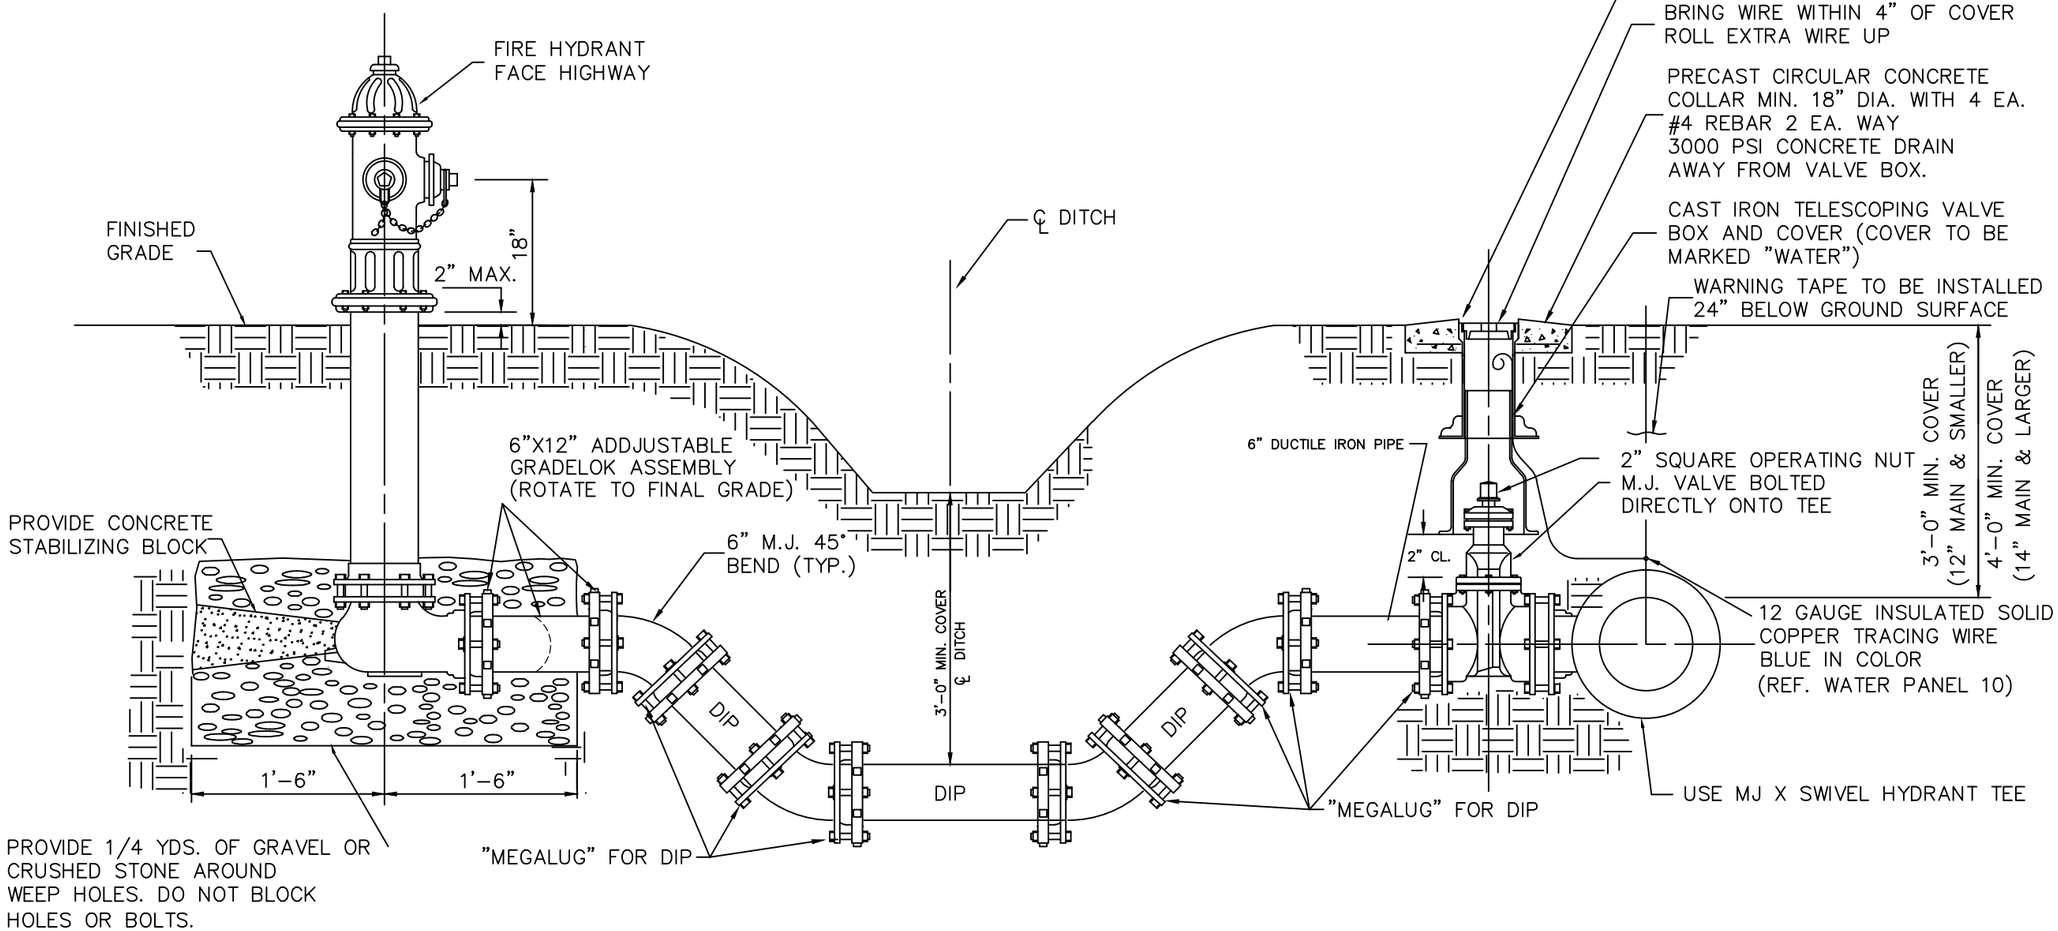

TYPICAL DETAIL
FIRE HYDRANT WITH VALVE AND BOX FOR DRAINAGE CROSSING

NOT TO SCALE

WATER PANEL 4B

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS
REVISED 05/15/20