


NOTE:

1. POST HYDRANT TO BE USED ON MAINS SMALLER THAN 6" (UNLESS SPECIFIED BY BCWS).

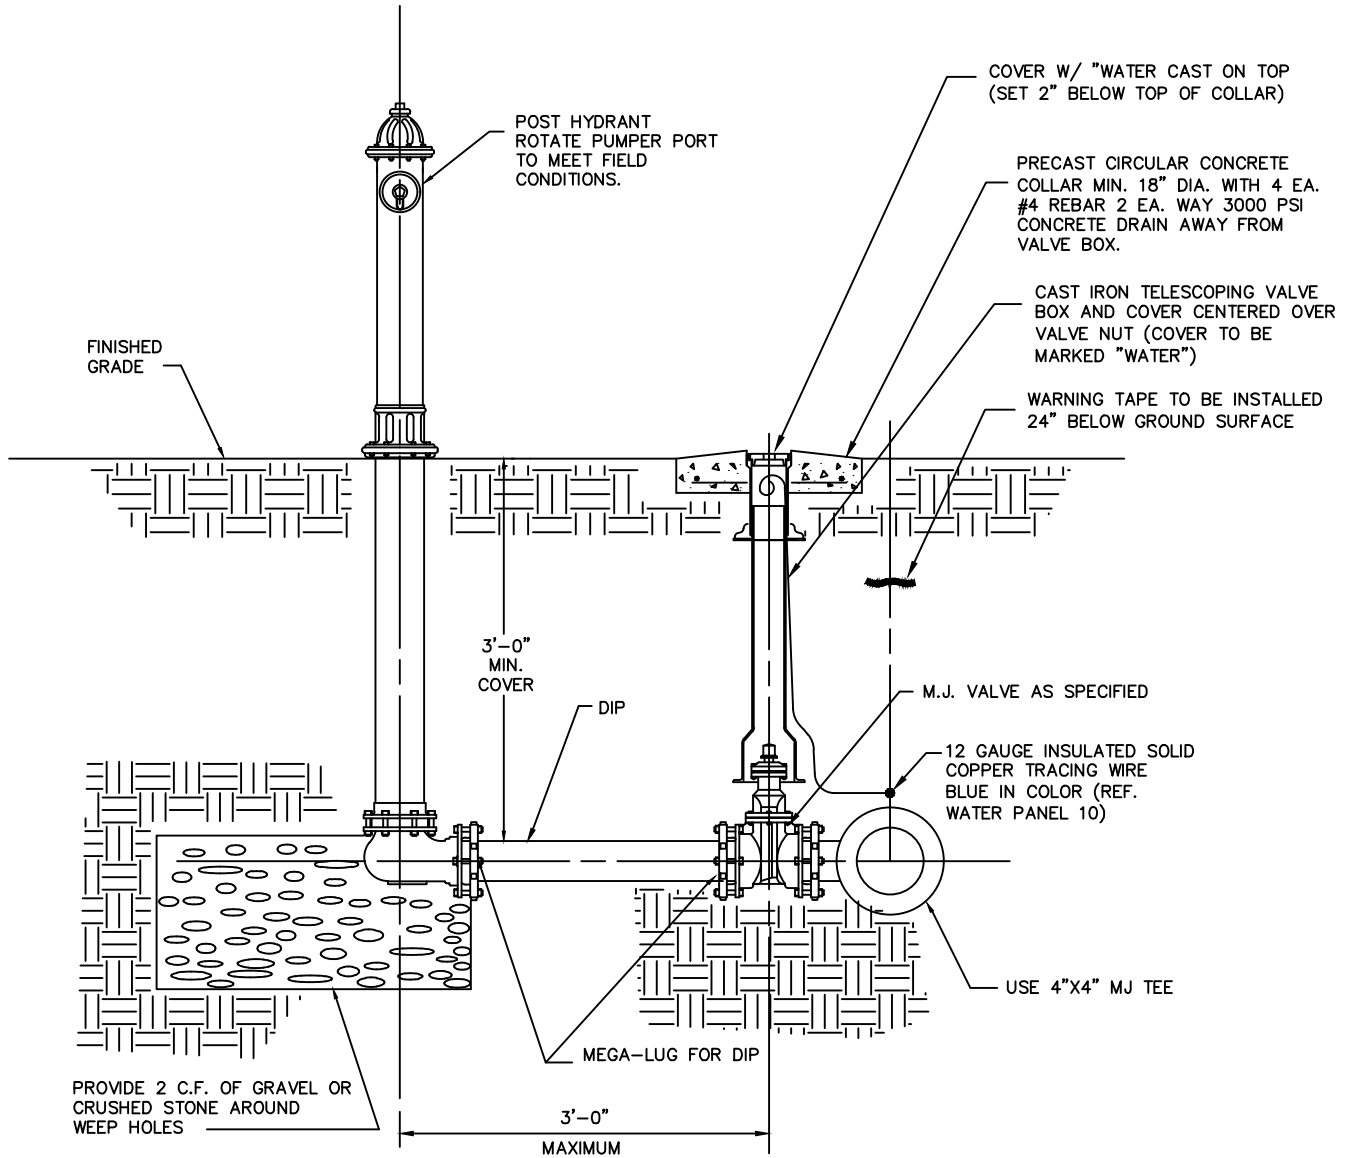

TYPICAL DETAIL

POST HYDRANT WITH VALVE AND BOX

NOT TO SCALE

WATER PANEL 4C

**BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED 05/15/20