


BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS


REVISED 03/04/15

NOTE

1. ALL LINE CROSSINGS SHALL BE IN ACCORDANCE WITH TEN STATES STANDARDS.
2. VERTICAL CLEARANCE SHALL BE 24" MINIMUM AT ALL WATER & STORM DRAINAGE CROSSINGS.
3. VERTICAL CLEARANCE SHOULD BE 24" MINIMUM AT ALL SANITARY SEWER & STORM DRAINAGE CROSSINGS. PLEASE SEE BCWS SPECIFICATIONS IF LESS THAN 24" CLEARANCE.
4. WATER AND SANITARY SEWER CROSSINGS SHALL HAVE A 18" MINIMUM VERTICAL CLEARANCE.

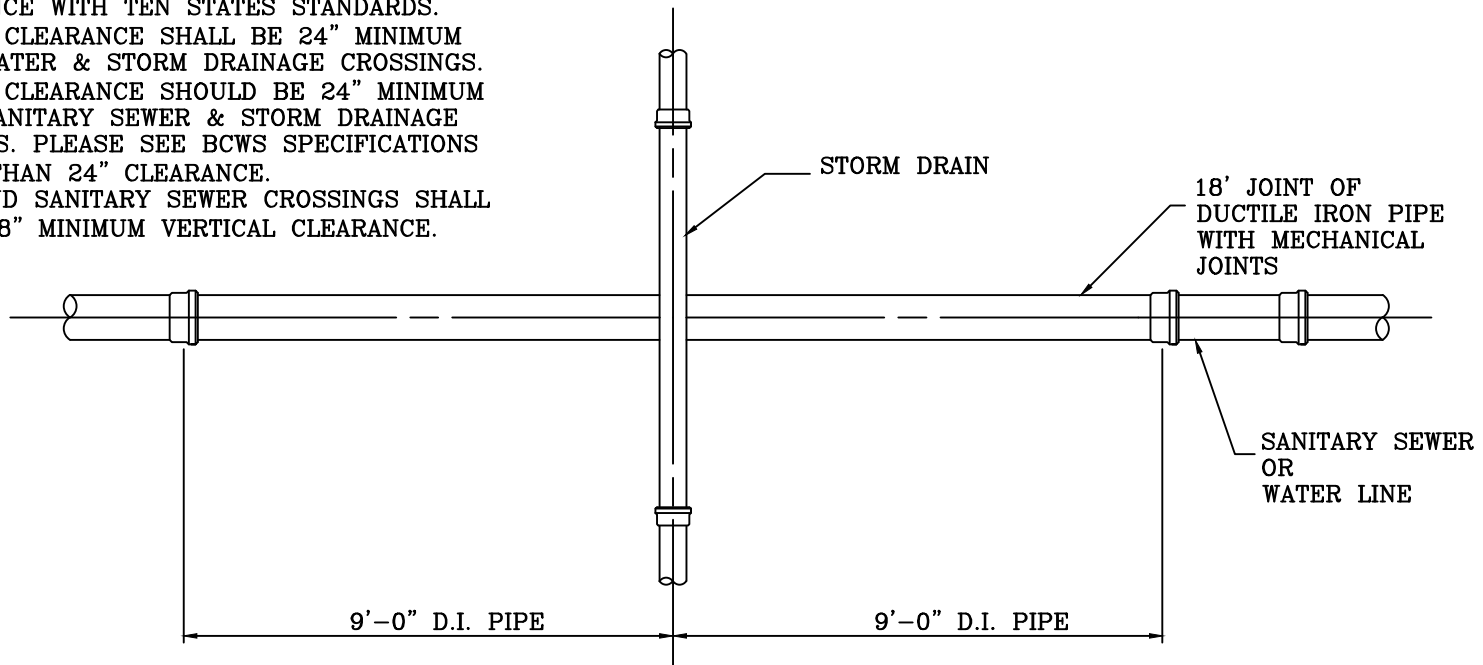

PLAN

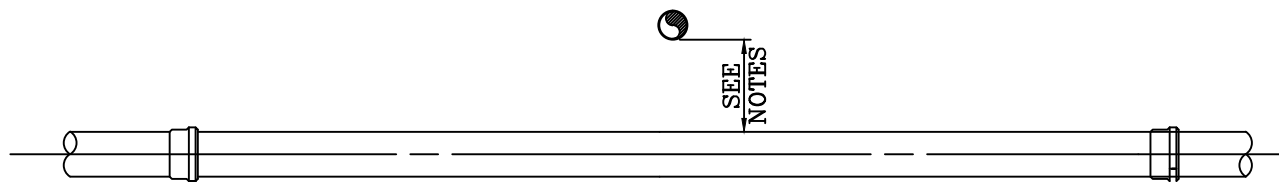

SECTION

NOT TO SCALE